


TRAILER SERVICE POLE— MINIMUM 20 FEET LONG, PRESSURE TREATED, 6 INCH DIAMETER, PROVIDED AND INSTALLED BY CONSUMER. GUYING MAY BE REQUIRED IF DICTATED BY SOIL CONDITIONS OR SERVICE LENGTH. HEIGHT TO BE INCREASED IF REQUIRED FOR CLEARANCE OVER DRIVEWAYS, YARDS, ECT. POLE HEIGHT AND GUYING TO BE SPECIFIED BY CO-OP ENGINEERING.

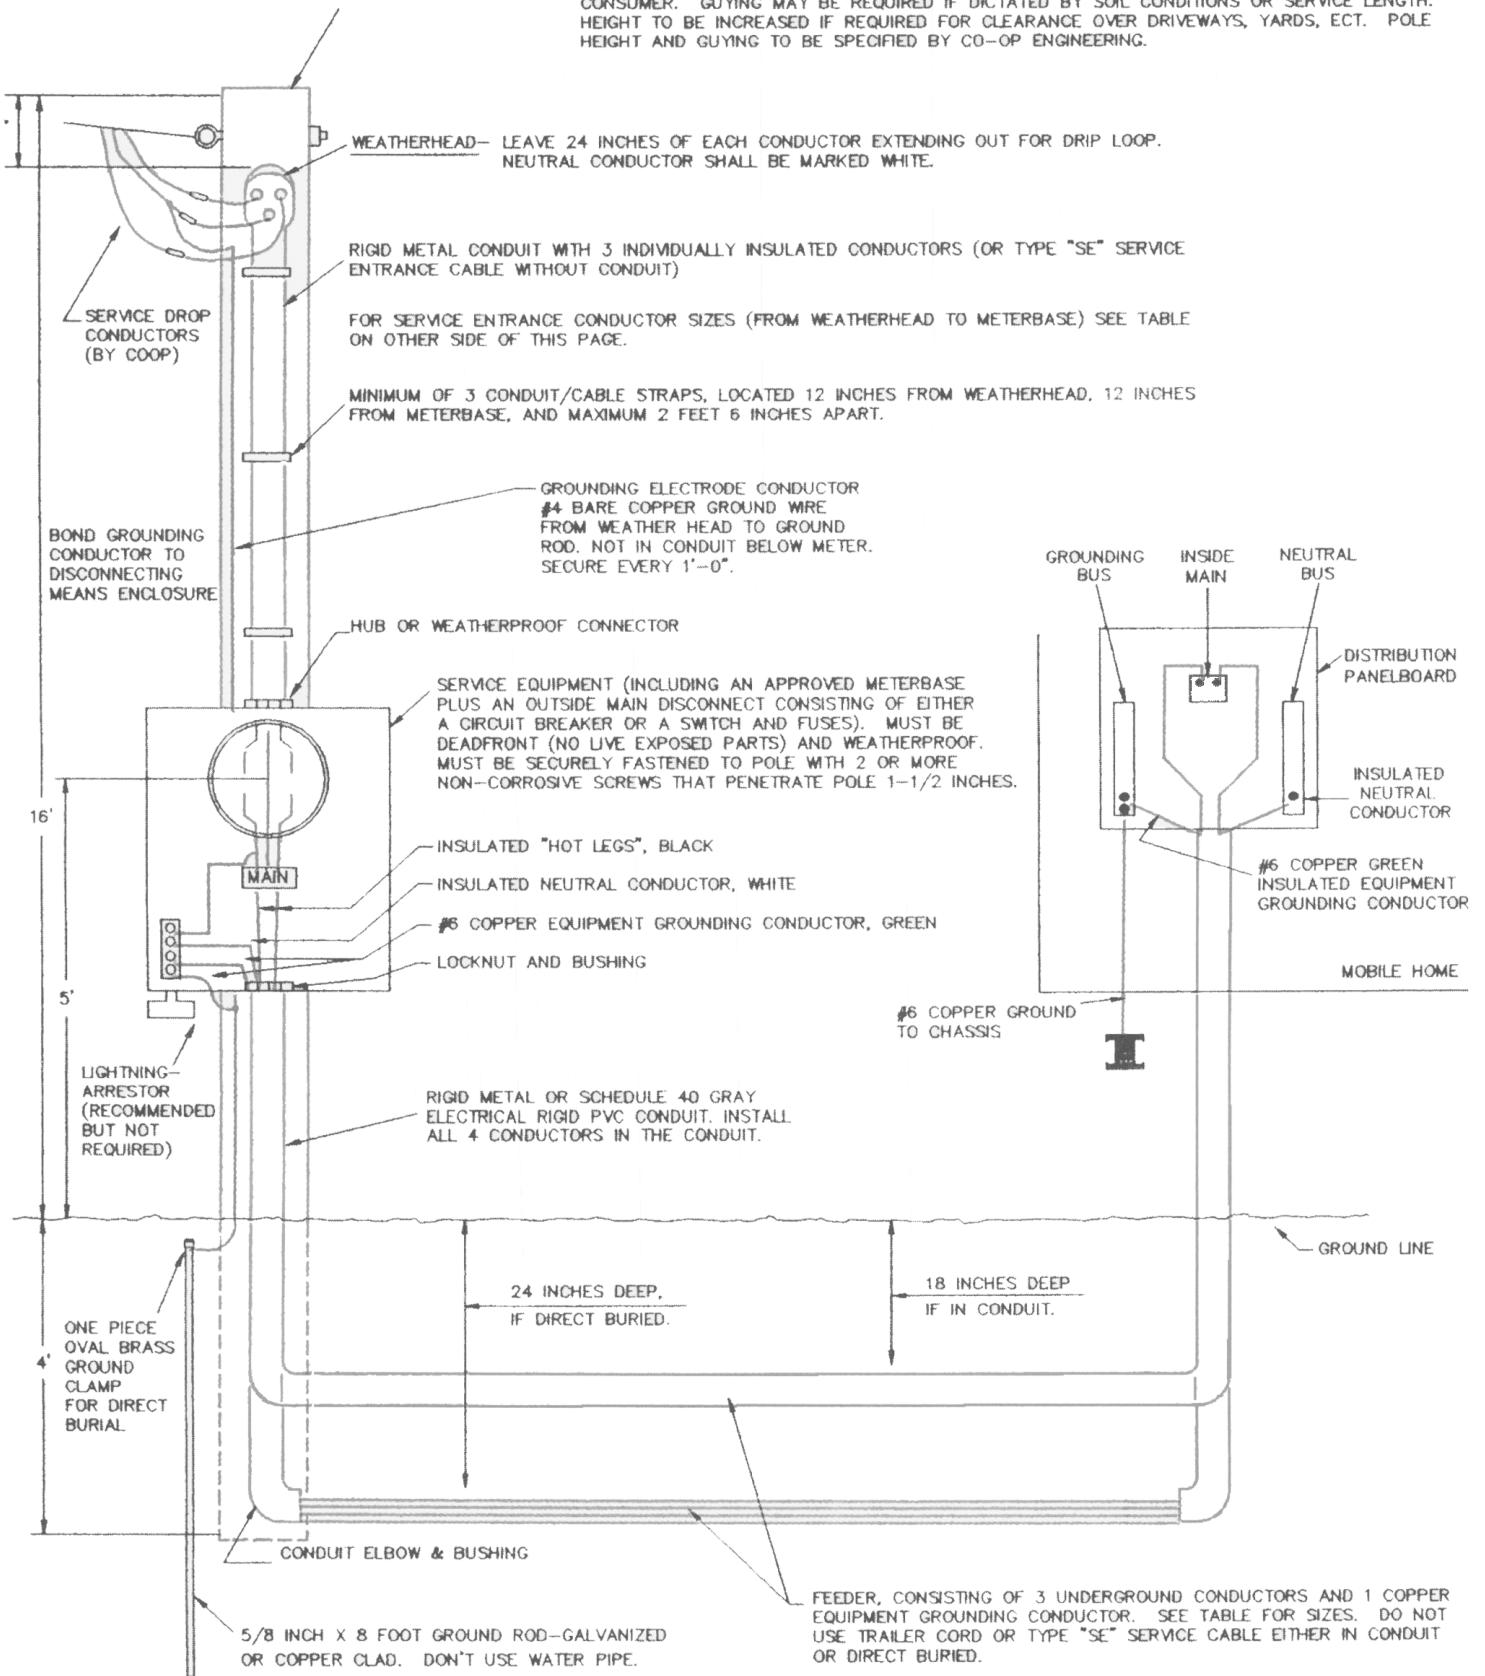

MOBILE HOMES EQUIPPED WITH POWER SUPPLY CORD AND PLUG RATED 40 AMPS OR 50 AMPS SHALL BE CONNECTED TO OUTSIDE SERVICE EQUIPMENT THROUGH A COMPATIBLE FEMALE RECEPTACLE AND SHALL BE PROTECTED BY A CIRCUIT BREAKER OR FUSE OF EQUAL RATING.

MOBILE HOME PARKS AND GROUPS OF TRAILERS WILL BE ENGINEERED ON AN INDIVIDUAL BASIS BY COOP PER NATIONAL ELECTRIC CODE.

CONTACT JOE WHEELER ENGINEERING WITH QUESTIONS AT: 552-2340 FOR JULIE VEST, 552-2341 FOR DON OWENS, 552-2342 FOR AVERY MCELROY, 552-2337 FOR AMIE DUNN OR 552-2338 FOR JIMMY DAVIS